

Test Name: Durability and Sensitivity of the Water Alarm Gong

Test Instruction Code: ITE/LB.I-25

Test purpose: Measurement of the durability and sensitivity of the water alarm gong system.

Applicability domain: Water Alarm Gong

Standard number: (FM Standard)

Test method: After turning the apparatus on, the pressure shall be increased from zero. According to the standard, the system shall be able to operate at the specified pressure and work continuously for the duration as defined in the standard without any problems or faults.

نام آزمون: دوام و حساسیت زنگ هشدار آبی

کد دستورالعمل آزمون: ITE/LB.I-25


هدف از آزمون: سنجش میزان دوام و حساسیت

سیستم زنگ هشدار آبی.

دامنه کاربرد: زنگ هشدار آبی

شماره استاندارد: (FM Standard)

روش آزمون: پس از روشن نمودن دستگاه، فشار را از صفر افزایش می دهیم. طبق استاندارد می بایست دستگاه در فشار تعریف شده عمل نموده و طی زمان تعریف شده در استاندارد، بدون ایراد و به صورت پیوسته کار کند.

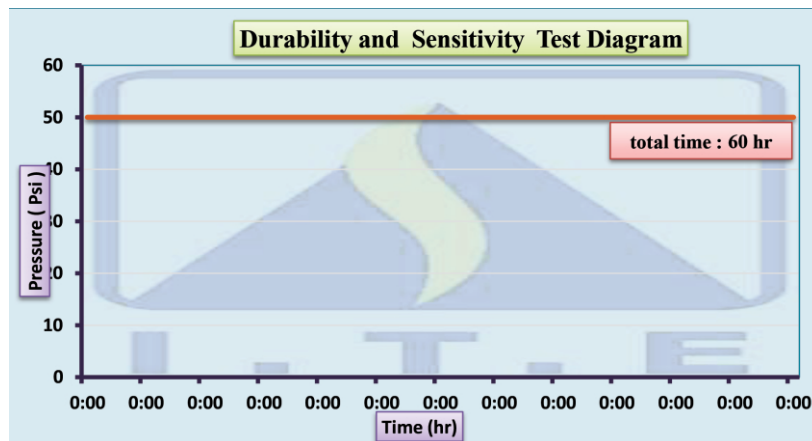

آزمون دوام و حساسیت زنگ هشدار آبی

Durability and sensitivity of the water alarm gong test

